



# model 7501T

Tempered, Gravity-Fed, Portable Eyewash

## FEATURES & BENEFITS

### CONSTRUCTION

FDA approved high-density green polyethylene tank provides the light and durable construction required in a portable unit.

### MOUNTING

J-shaped stainless steel wall bracket makes for a well constructed portable mount for easy removal and re-mount.

### FLOW CONTROLS

Pulling down the eyewash arm will begin flushing the 9-gallon (34.1 L) portable tank at .4 gpm (1.5 L) for a full 15 minutes, creating a full patterned flushing of the eyes.

### DESIGN

Tank comes complete with a wide-fill opening and threaded cap for quick inspection, cleaning, and filling. Unit also comes equipped with top and side handles making relocation easy.

### TEMPERED WATER

Heated, insulated blanket provides ANSI compliant tempered potable water in operating temperatures to -30° F (-34° C). Unit will stay tempered in non-extreme outdoor conditions (below 100° F (38° C)). Only tempered portable eyewash in the market.

## OPTIONS

- Water Additive: Model 9082, 'sterile' bacteriostatic preservative for use in portable eyewash stations. One 5 oz. (148 ml) bottle will preserve 5 to 20 gallons (18.9 to 75.7 L) of potable water for up to three months. Four bottles per carton.
- Waste Container: Model 9009 is a twenty-gallon (75.7 L) wastewater container constructed of tough yellow polymer resin. Unit is used to collect water during weekly testing of emergency equipment.

For more information, visit [www.hawesco.com](http://www.hawesco.com) or call (888) 640-4297.




## SPECIFICATIONS

Model 7501T is a 9-gallon (34 L), tempered, gravity-fed portable eyewash with a NEMA 3R heated, insulated blanket to provide ANSI compliant tempered potable water in ambient operating temperatures to -30° F (-34° C) and 100° F (38° C). Ideal for remote locations without access to continuous potable water. 120V, 50Hz electrical requirement with supplied 8' GFCI power cord. Voltage and Haz Loc options available. Model 9082 additive not included - order separately.

## APPLICATIONS

Where the eyes of any person may be exposed to injurious or corrosive materials, when suitable facilities for quick flushing of the eyes needs to be provided and a continuous supply of water is not available. Although the 7501T may be installed in a wide variety of locations, it is ideal for remote areas where protective measures are still needed. Emergency eyewash equipment shall be in unobstructed and accessible locations that require no more than 10 seconds for the injured person to reach. IAPMO EGS certified to ANSI/ISEA Z358.1 - CSA C22.2 No. 88, UL499 and UL 1951

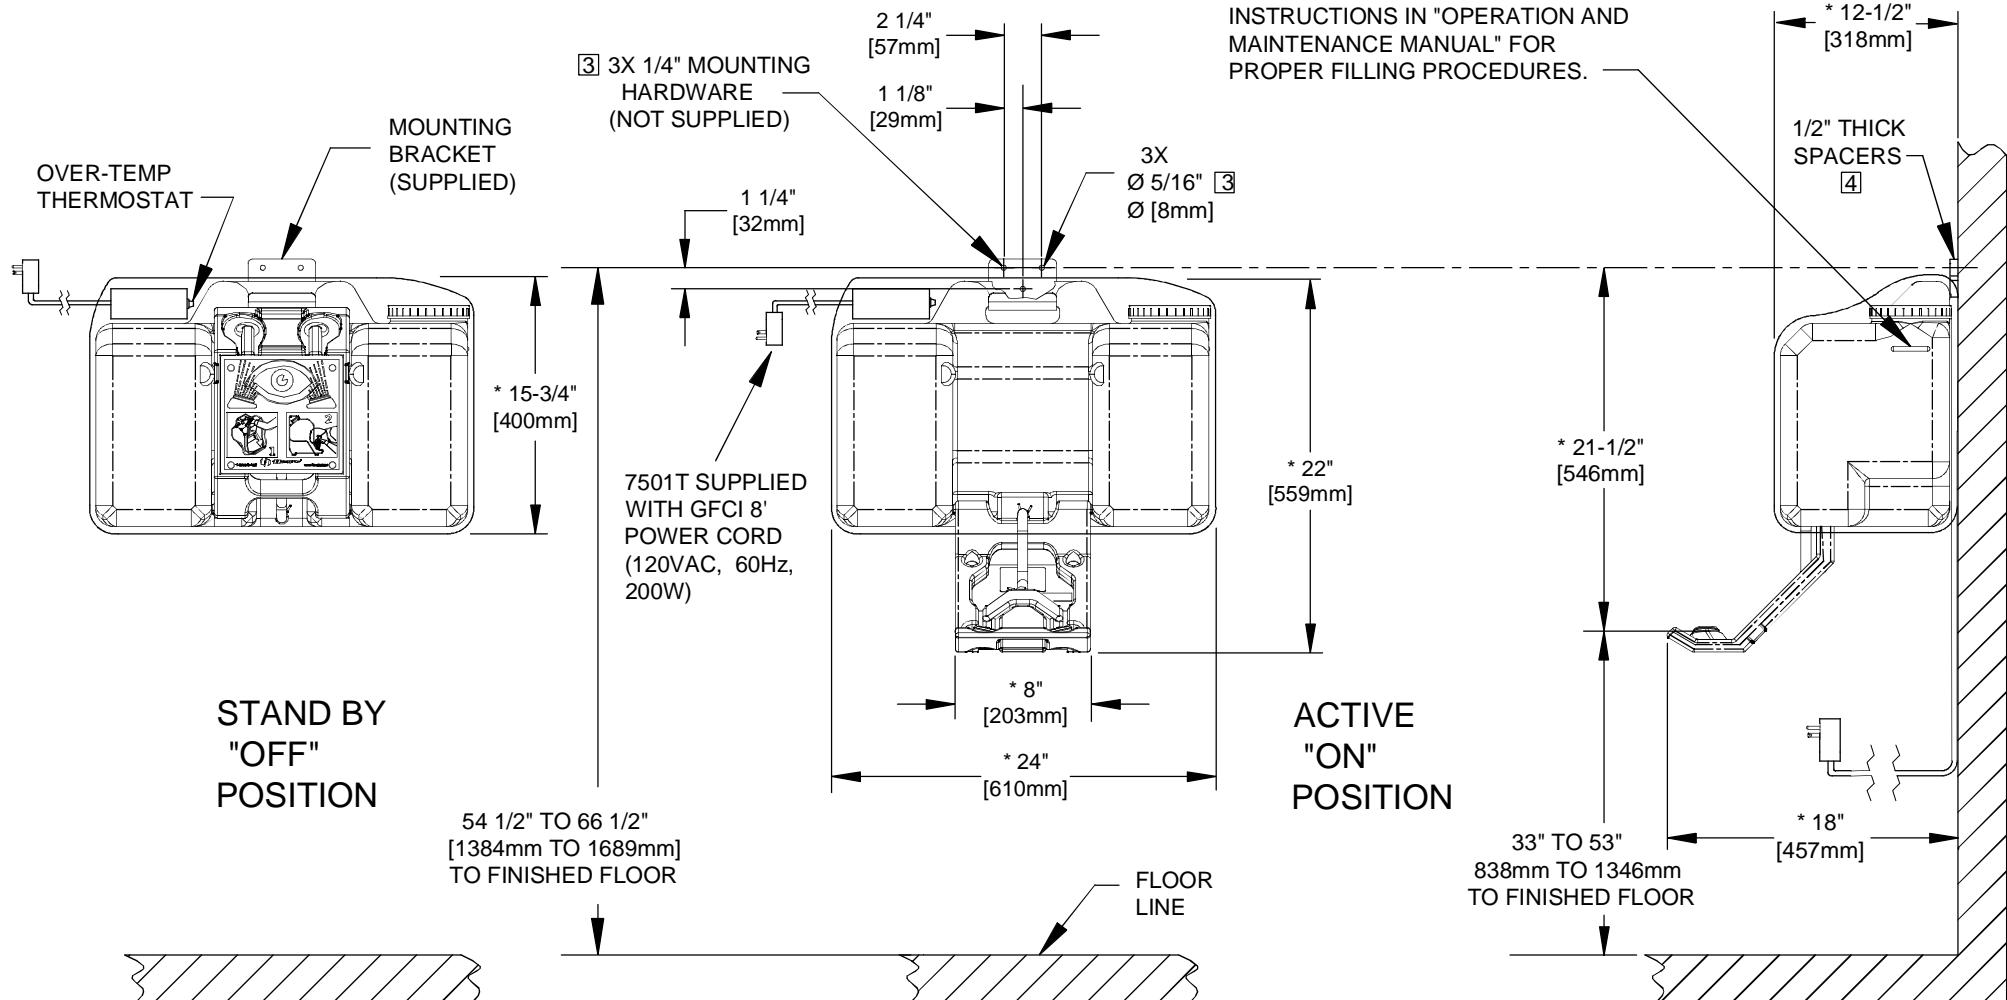

NOTES: (CONTINUED FROM SHEET 1 OF 2)

④ LOCATE ONE 1/2" THICK SPACER (QTY. 3 SUPPLIED) BEHIND EACH HOLE IN THE MOUNTING BRACKET AS SHOWN.

5. \* DIMENSIONS MAY VARY  $\pm 1/2"$  [12.7mm].

6. **UNIT MUST BE FILLED WITH WATER BEFORE CONNECTING TO POWER SOURCE.**

(FOR MODELS 7501T240 & 7501BL240:)

7. CORD SET SHALL BE LISTED TO UL 817 AND CSA-C22.2 NO. 21 AND PROVIDED WITH 3 WIRE GROUNDING TYPE ATTACHMENT PLUG RATED 240 V, MIN. 15 A.

8. THE FLEXIBLE CORD TYPE SHALL BE TYPE S, SE, SJ, SJE, SJO, SJOO, SJT, SJTO, SJTOO, SO, SOO, ST, STO, OR STOO AND HAVE A TYPE LETTER SUFFIX OF "W," "W-A" OR "OUTDOOR."

9. THE CORD SET SHALL BE MIN. 6 FT IN LENGTH AND MIN 18 AWG SIZE FOR FLEXIBLE POWER SUPPLY CORD.

10. LISTED STRAIN RELIEF BUSHING SUITABLE FOR CORD SET SIZE AND OUTDOOR USE SHALL BE USED.

11. THE FIELD INSTALLED POWER SUPPLY CORD SET NEEDS TO BE INSTALLED BY QUALIFIED PERSONNEL.

DO NOT EXCEED WATER FILL LINE. REFER TO INSTALLATION INSTRUCTIONS IN "OPERATION AND MAINTENANCE MANUAL" FOR PROPER FILLING PROCEDURES.

**MOUNTING DETAIL FOR:**  
MODELS 7501T/7501TH/7501T240/7501T240H -  
WITH HEATED BLANKET (SHOWN)  
MODEL 7501 (SEE SHEET 1 OF 2)

ECN NO. 5086		REVISED PER ECN: 5139	BY: CC	MODEL(S)	PART NUMBER 0002080045.D
DRAWN: MJ	DATE: 06/30/16	CHK'D: VWC		PORTABLE EYEWASH	REVISION 15
APPROVED: FV	DATE: 09/21/16	SCALE: 1:1	DRAWING TYPE: INSTALLATION	SIZE: A	WEBSITE: WWW.HAWSCO.COM