


NOTES:

1. TO COMPLY WITH ANSI Z358.1-2009 FOR EMERGENCY EYEWASH OR EYE/FACE WASH AND SHOWER EQUIPMENT:
- UNIT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS AND ACCEPTABLE PLUMBING PRACTICES.
 - EYEWASH OR EYE/FACE WASH SHALL BE POSITIONED WITH NOZZLES NOT LESS THEN 83.8 CM (33 IN.) AND NO GREATER THAN 114.3 CM (45 IN.) FROM SURFACE ON WHICH USER STANDS AND 15.3 CM (6 IN.) MINIMUM FROM WALL OR NEAREST OBSTRUCTION.


2. *DIMENSIONS MAY VARY ±1/2" [12.7mm].

3. CENTERLINE WASTE PLACED 9"[229mm] MIN. FROM OBSTRUCTION.



4 DIM APPLIES WHEN OPTIONAL 9102 DUST COVER ASSEMBLY IS USED.

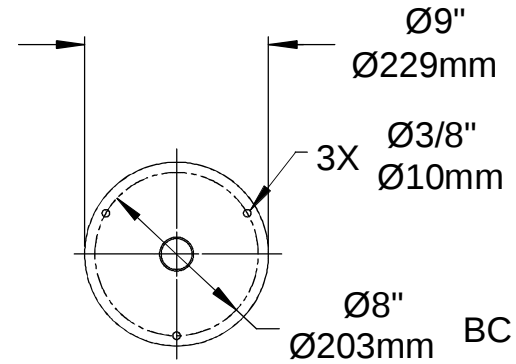

MOUNTING DETAIL



SIGN IS TO BE POSITIONED SUCH THAT IT IS VISIBLE WITHIN THE AREA SERVED BY THE EYEWASH

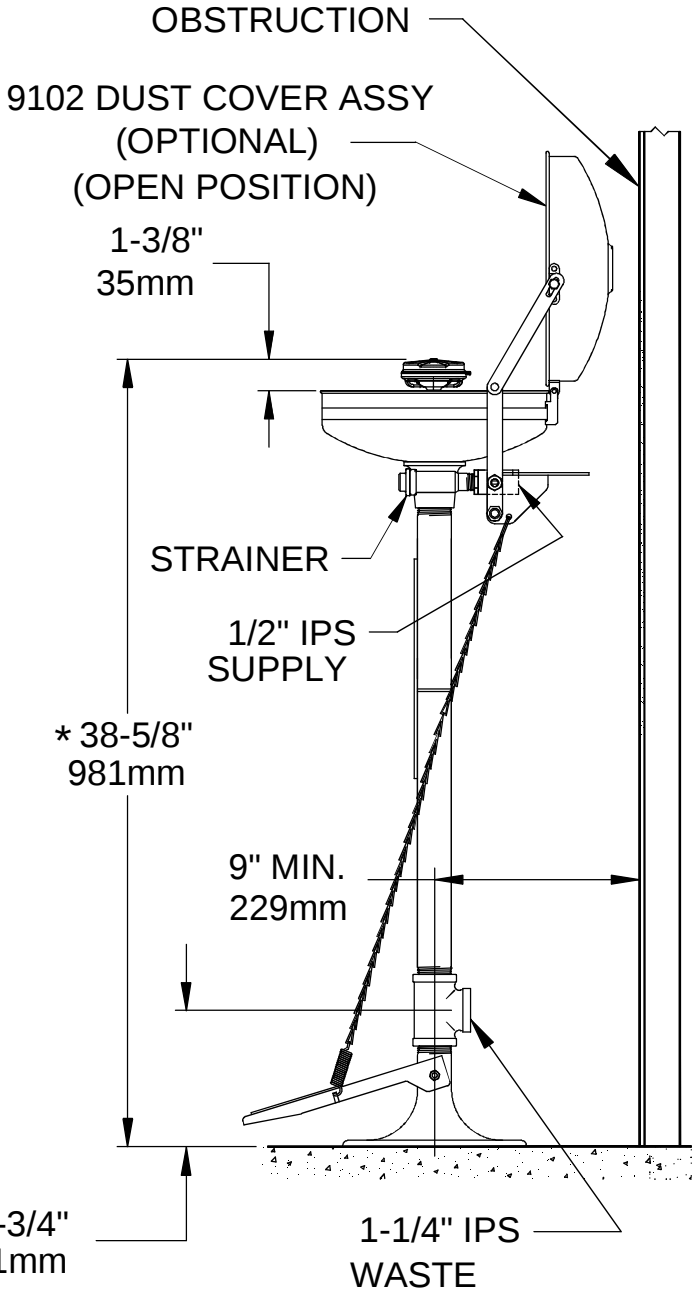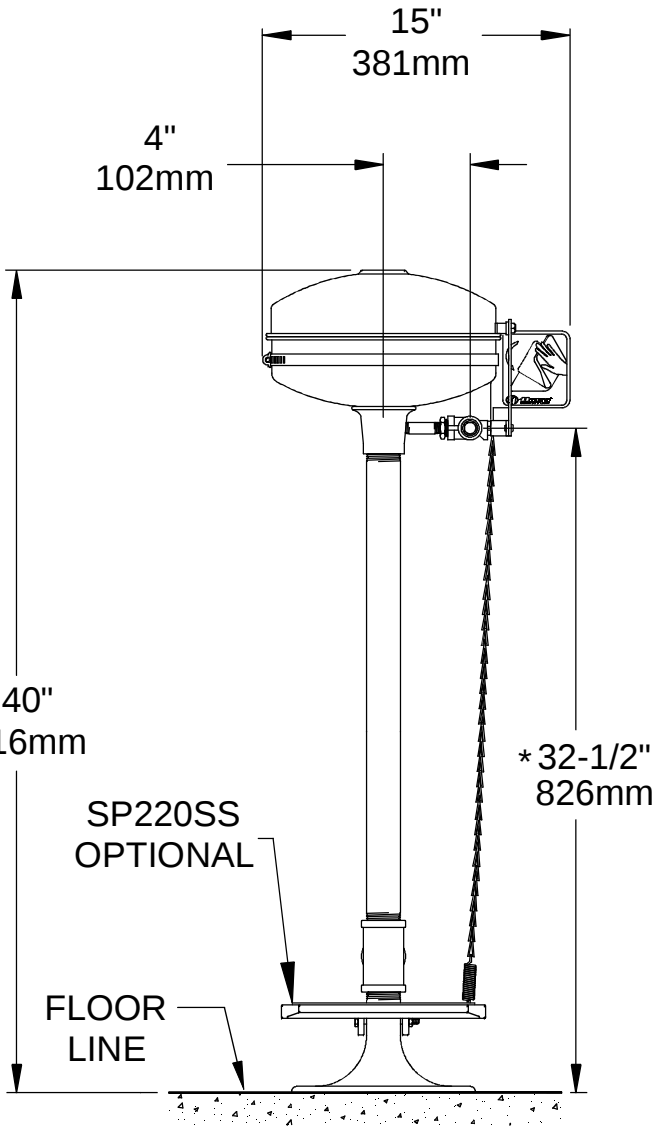



1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWSO.COM
WEBSITE: WWW.HAWSO.COM

ECN NO. 5133	REVISED PER CJC	MODEL(S)	7777	PART NUMBER 0002080102.D
DRAWN: C.JL	DATE: 05/91	CHKD: VWC	SS PED MTD EYE/FACE WASH	REVISION 15
APPROVED: FV	DATE: 09/01/16	SCALE: 1/10	DRAWING TYPE: INSTALLATION	SIZE: A SHEET 1 OF 1