


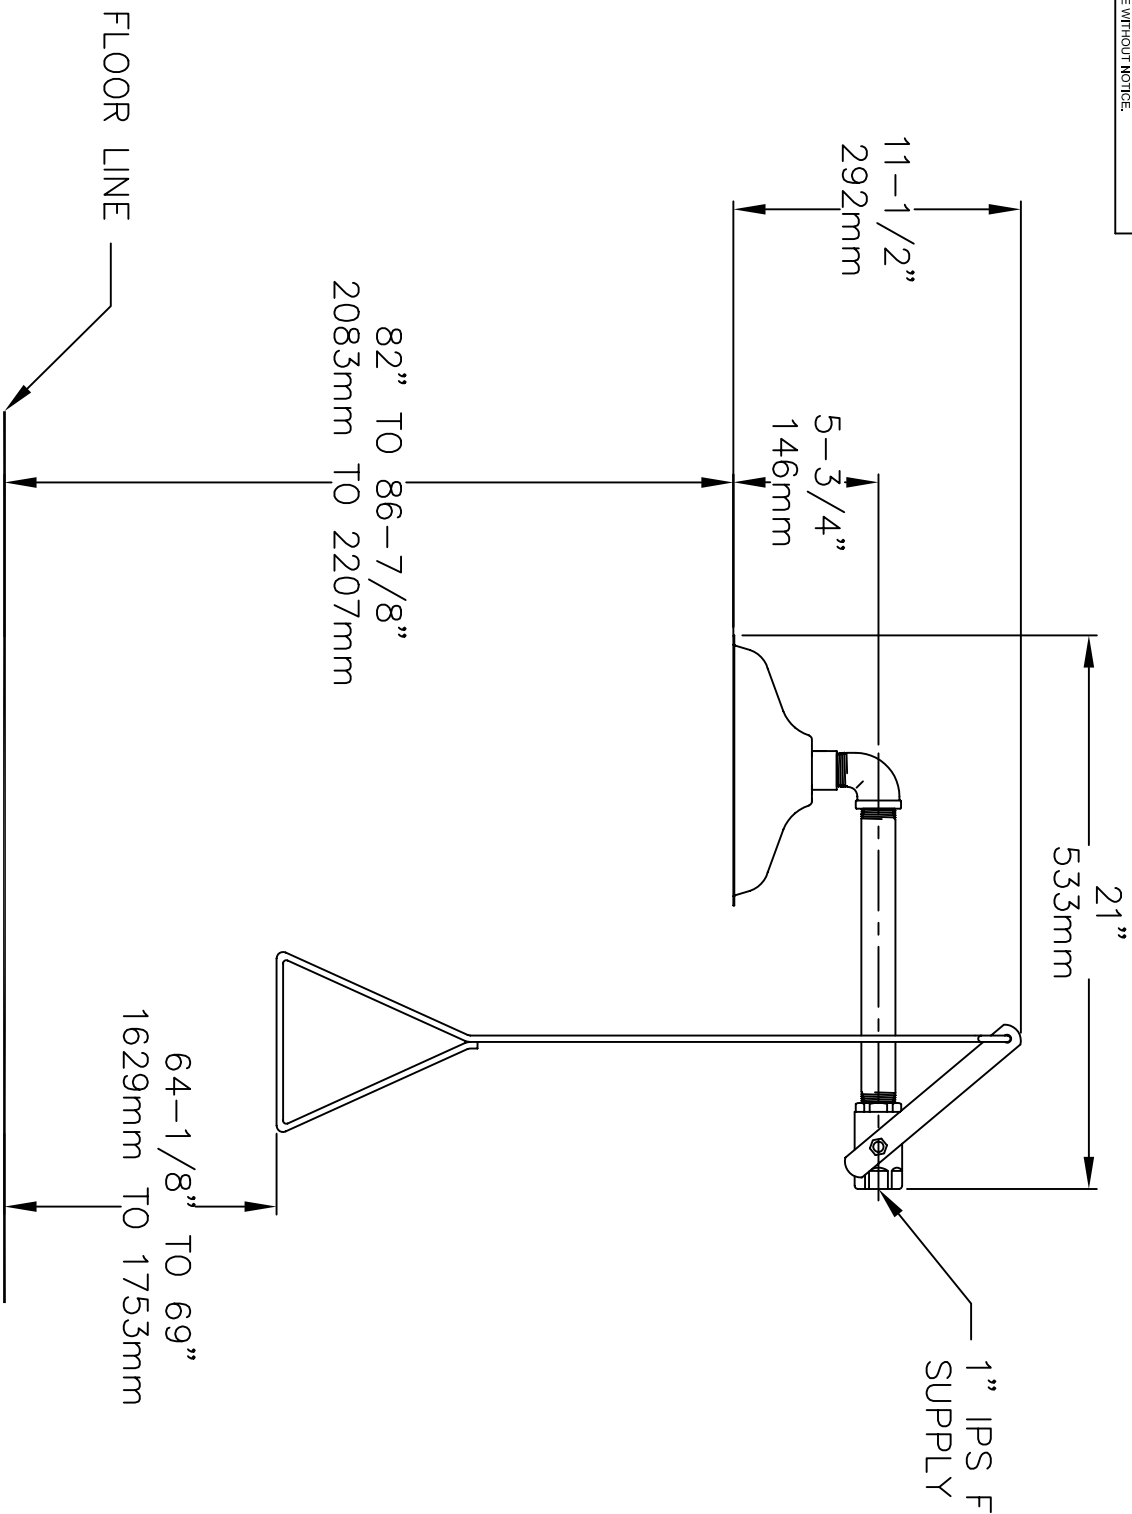

NOTES:

1. TO COMPLY WITH ANSI Z358.1-2009 FOR EMERGENCY SHOWER EQUIPMENT:

- UNIT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS AND ACCEPTABLE PLUMBING PRACTICES.

- SHOWER SHALL BE POSITIONED SO THAT SHOWER HEAD IS NOT LESS THAN 208.3 CM (82 IN.) NOR MORE THAN 243.8 CM (96 IN.) FROM SURFACE ON WHICH USER STANDS.

- SHOWER SPRAY PATTERN SHALL HAVE A MINIMUM DIAMETER OF 50.8 CM (20 IN.) AT 152.4 CM (60 IN.) ABOVE SURFACE ON WHICH USER STANDS, AND CENTER OF SPRAY PATTERN SHALL BE LOCATED AT LEAST 40.6 CM (16 IN.) FROM ANY OBSTRUCTION.

- DIMENSIONS MAY VARY $\pm 1/2"$ [12.7mm].



Haws

1455 KLEPPLE LANE

SPARKS, NEVADA 89431

(775) 359-4712 FAX (775) 359-7424

EMAIL: HAWS@HAWS.CO.COM

WEBSITE: WWW.HAWS.CO.COM

EQN NO.	REVISED PER BY:	MODEL(S)	PART NUMBER:
DRAWING	EQN: 4351 JR	8133H	0002080135.D
DATE	DATE	CHKD:	DATE
DESIGN	DATE	SHOWER	DATE
APPROVED:	DATE	SCALE: 1/8"	DRAWING TYPE: INSTALLATION
		SIZE: A	SHEET 1 OF 1